Figure 1

Figure 2

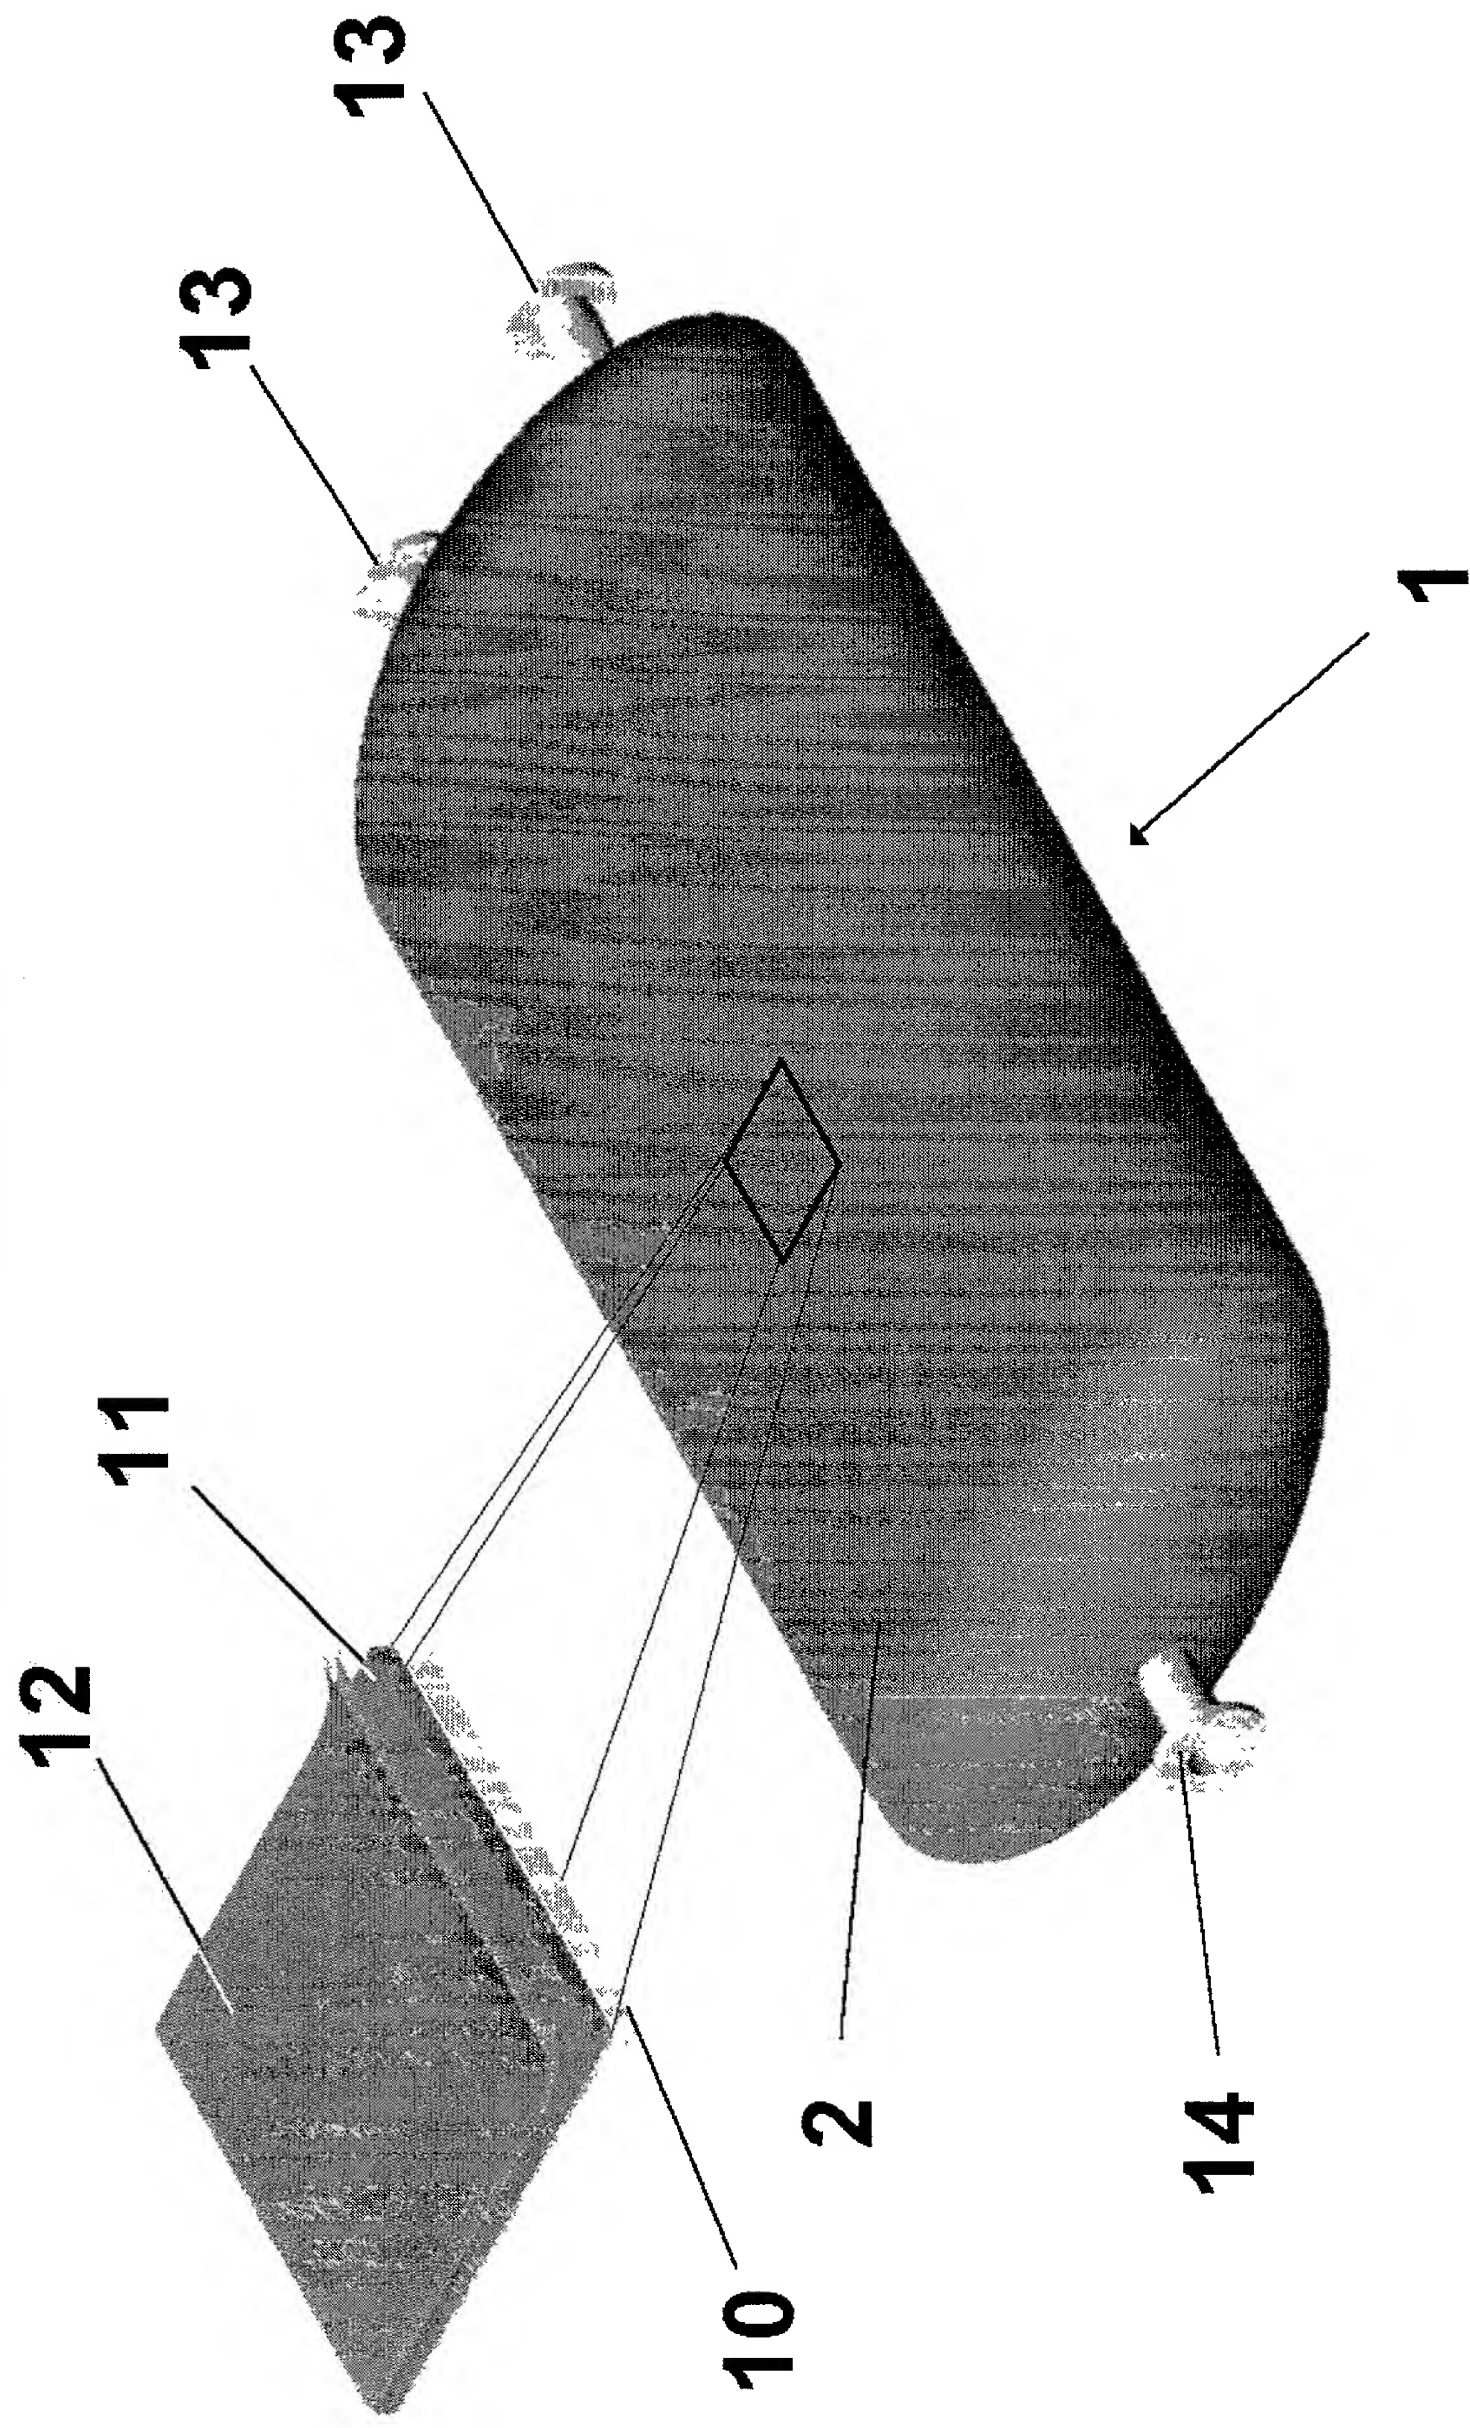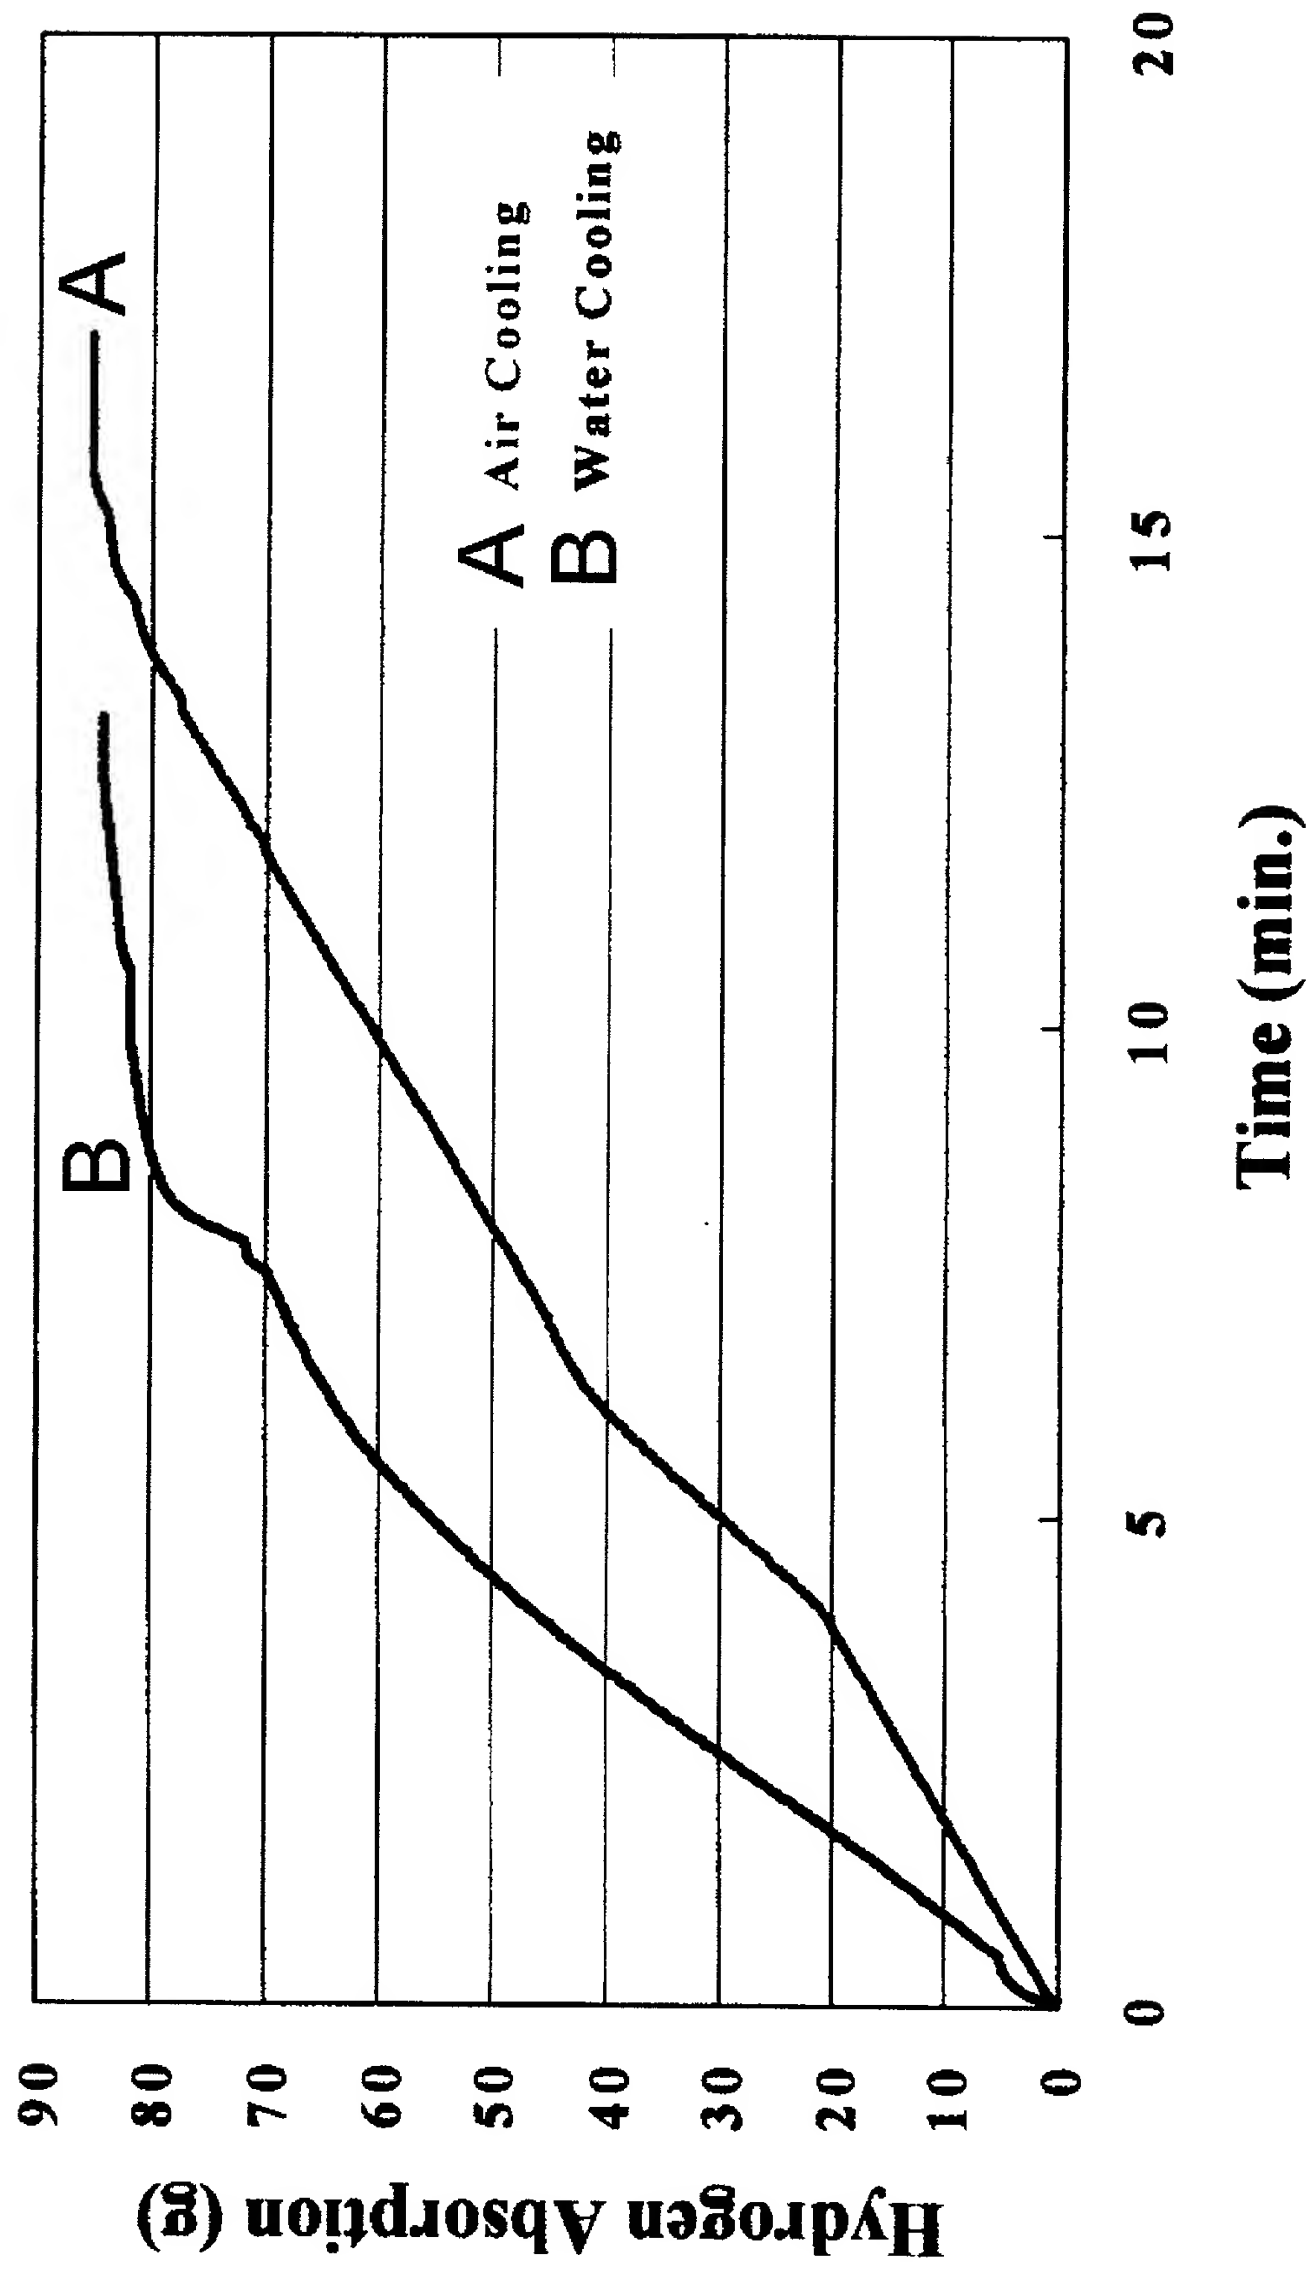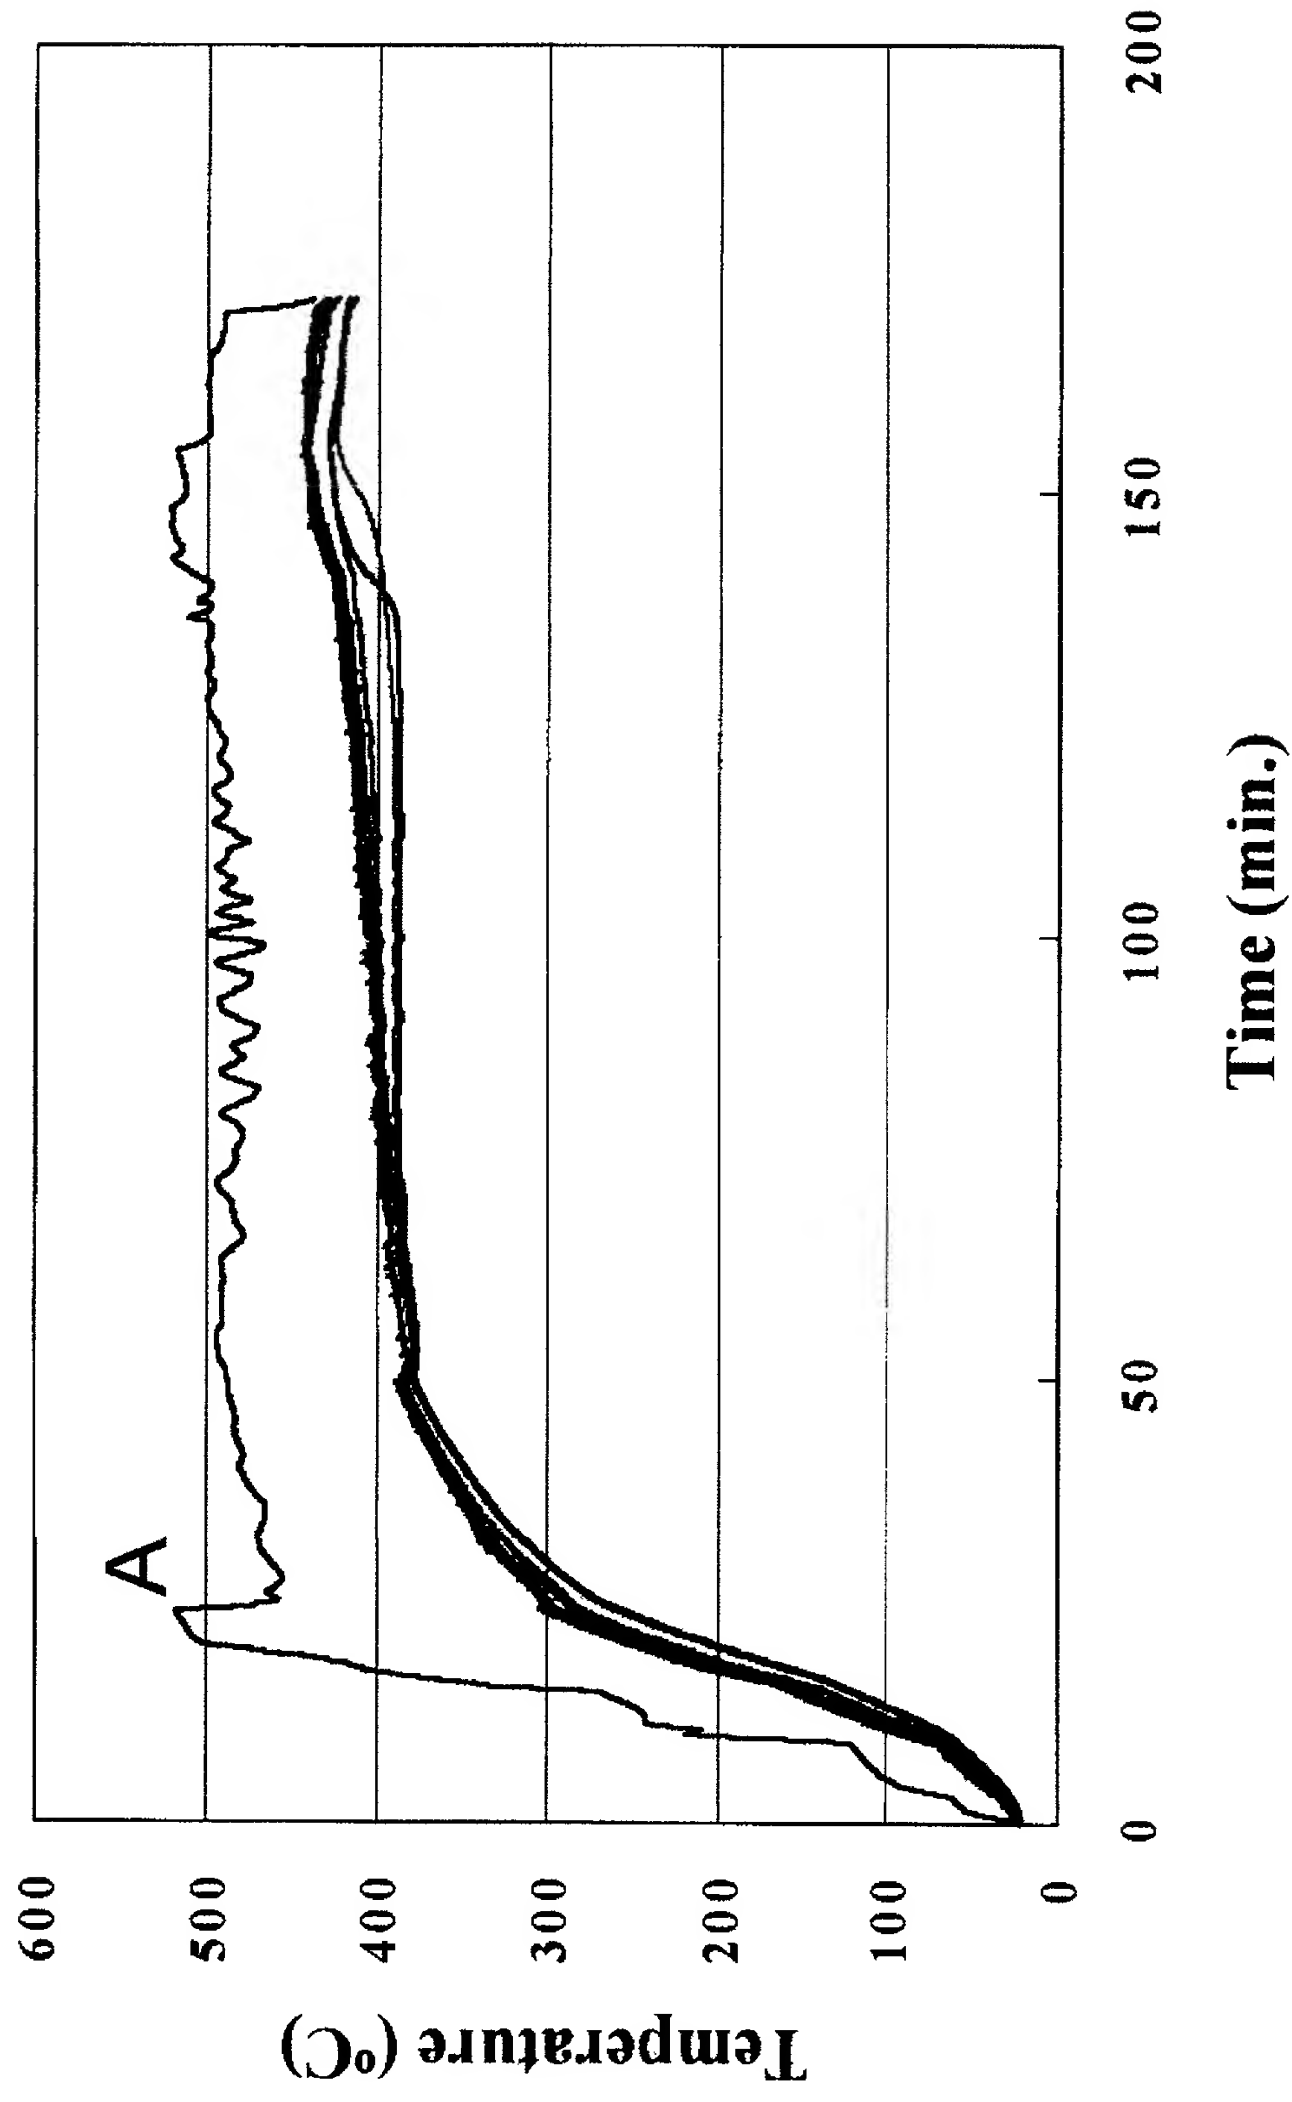**Figure 3**
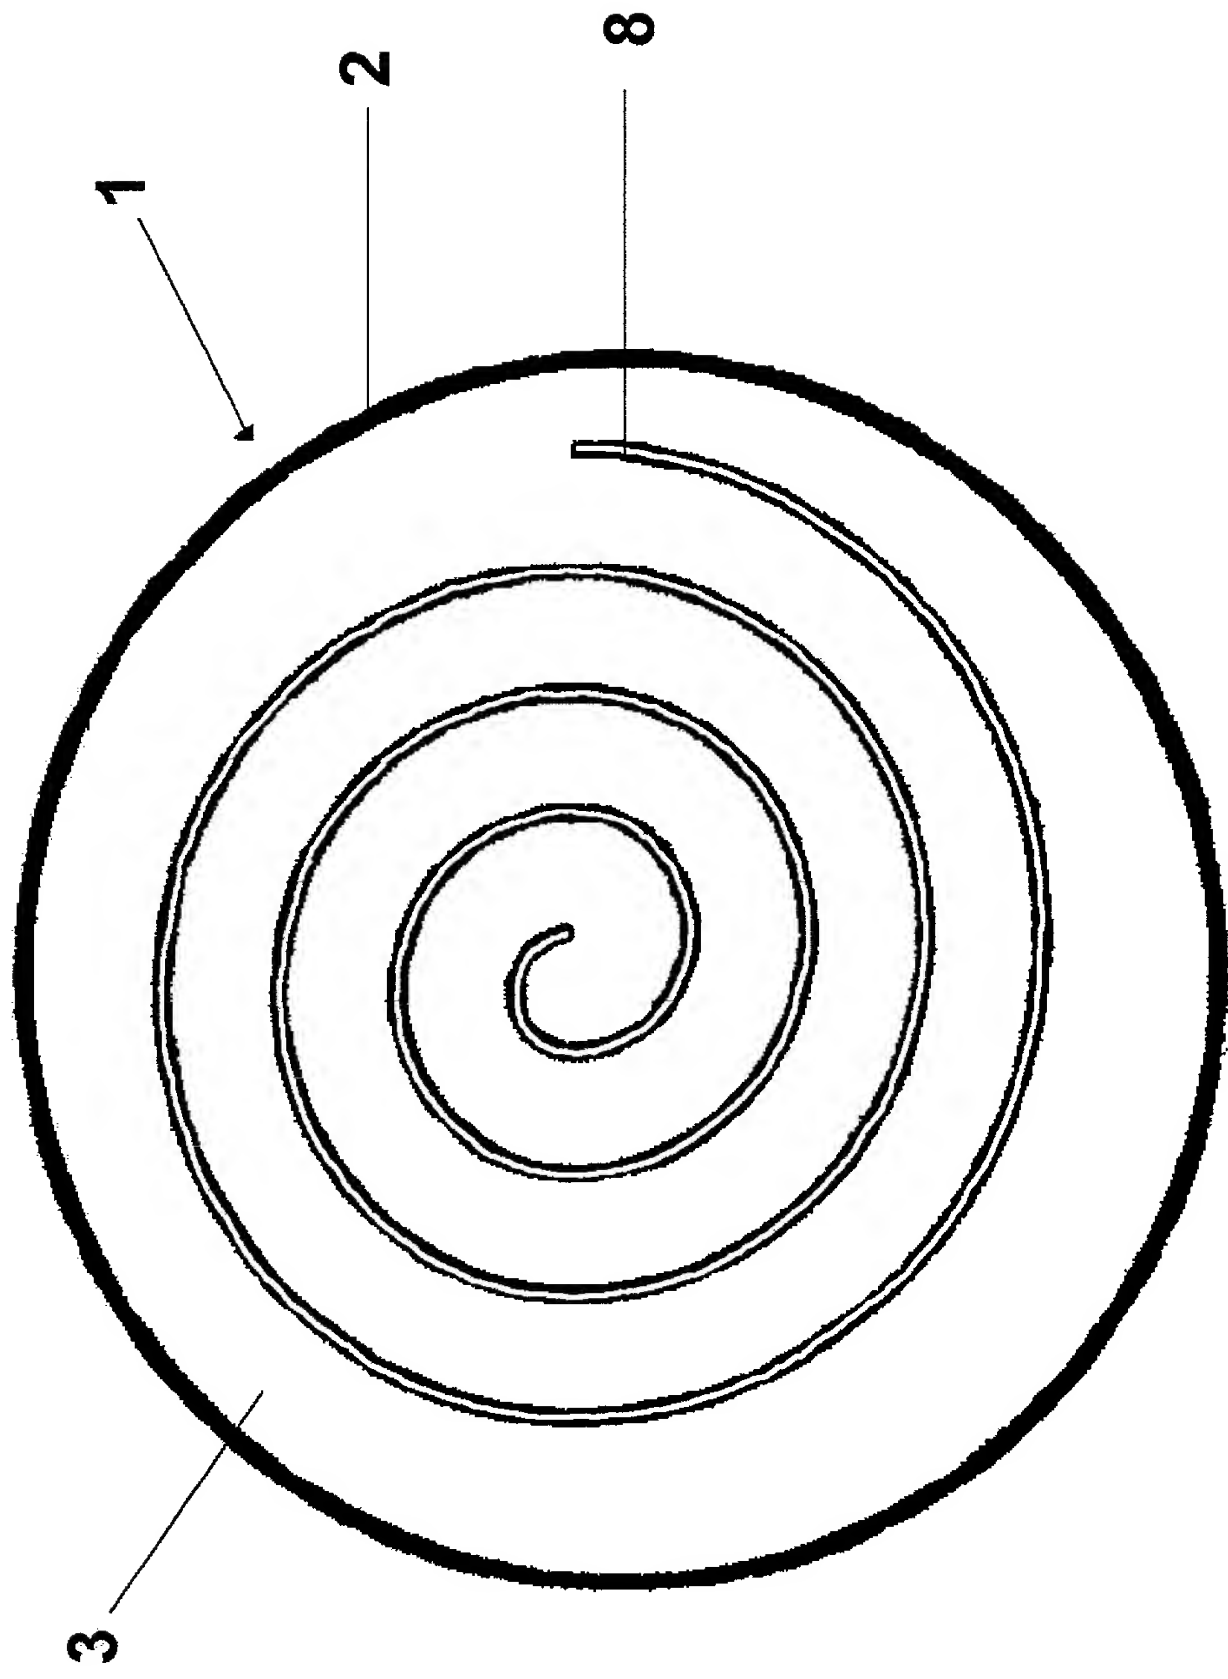
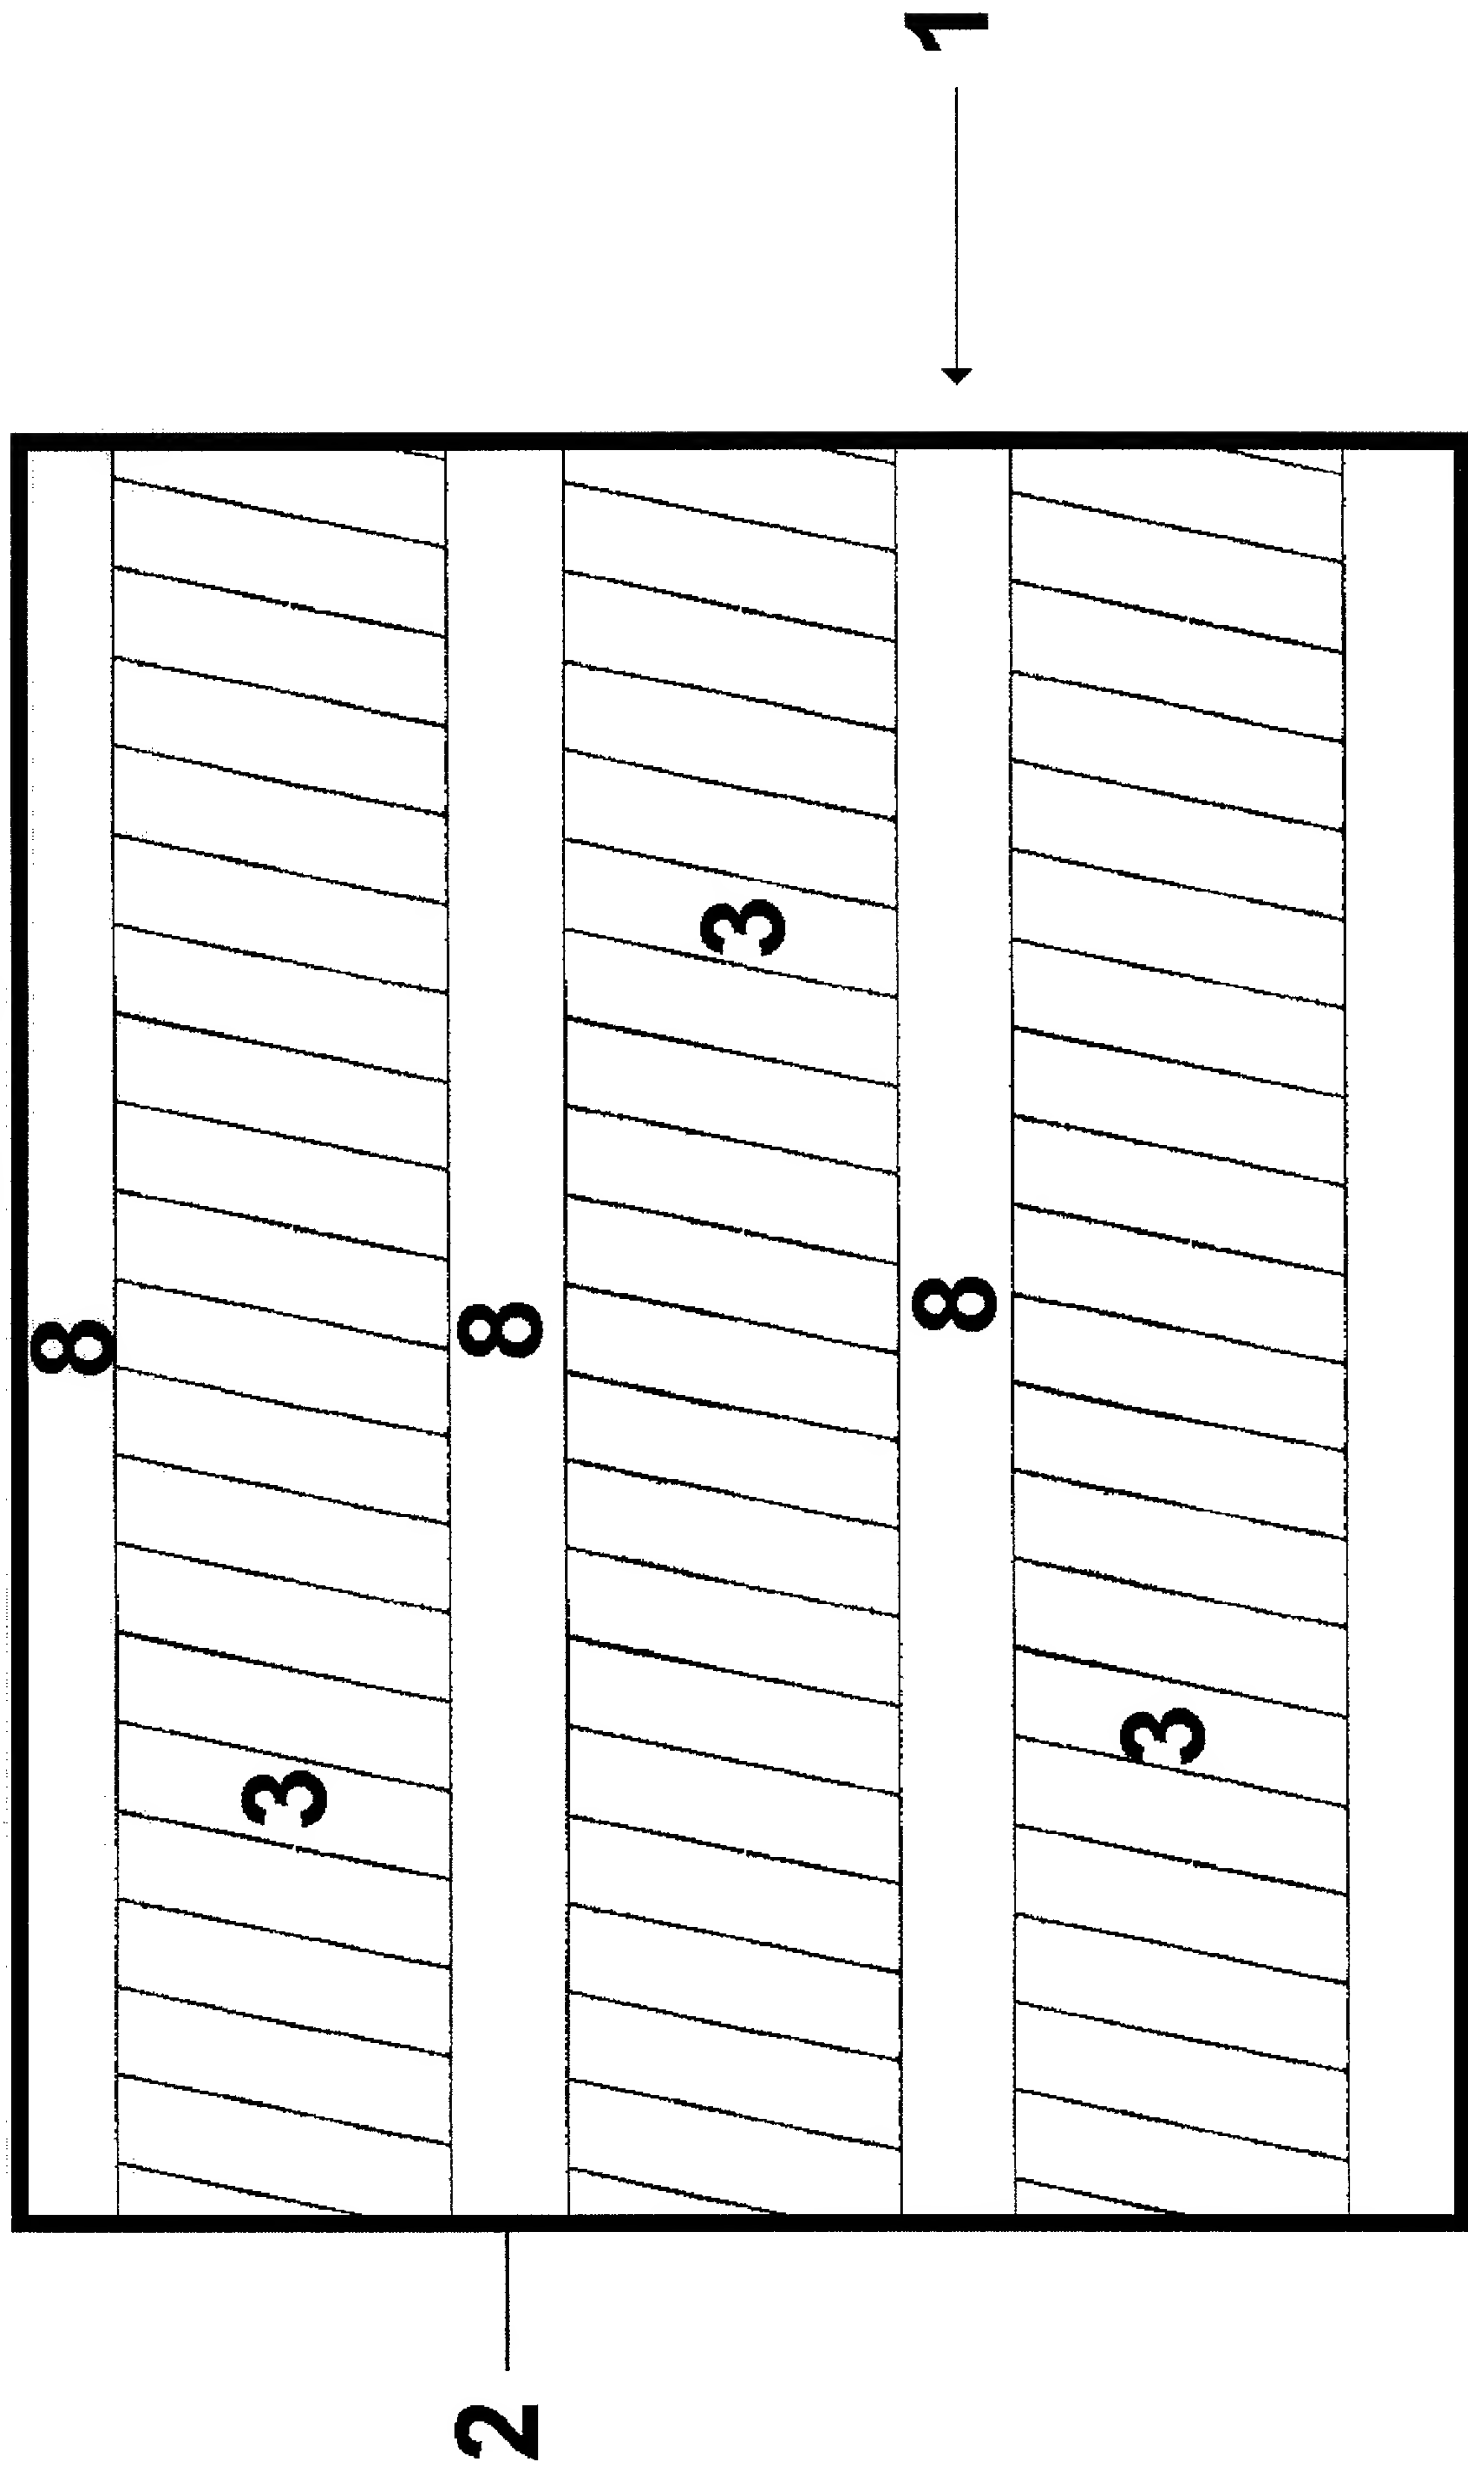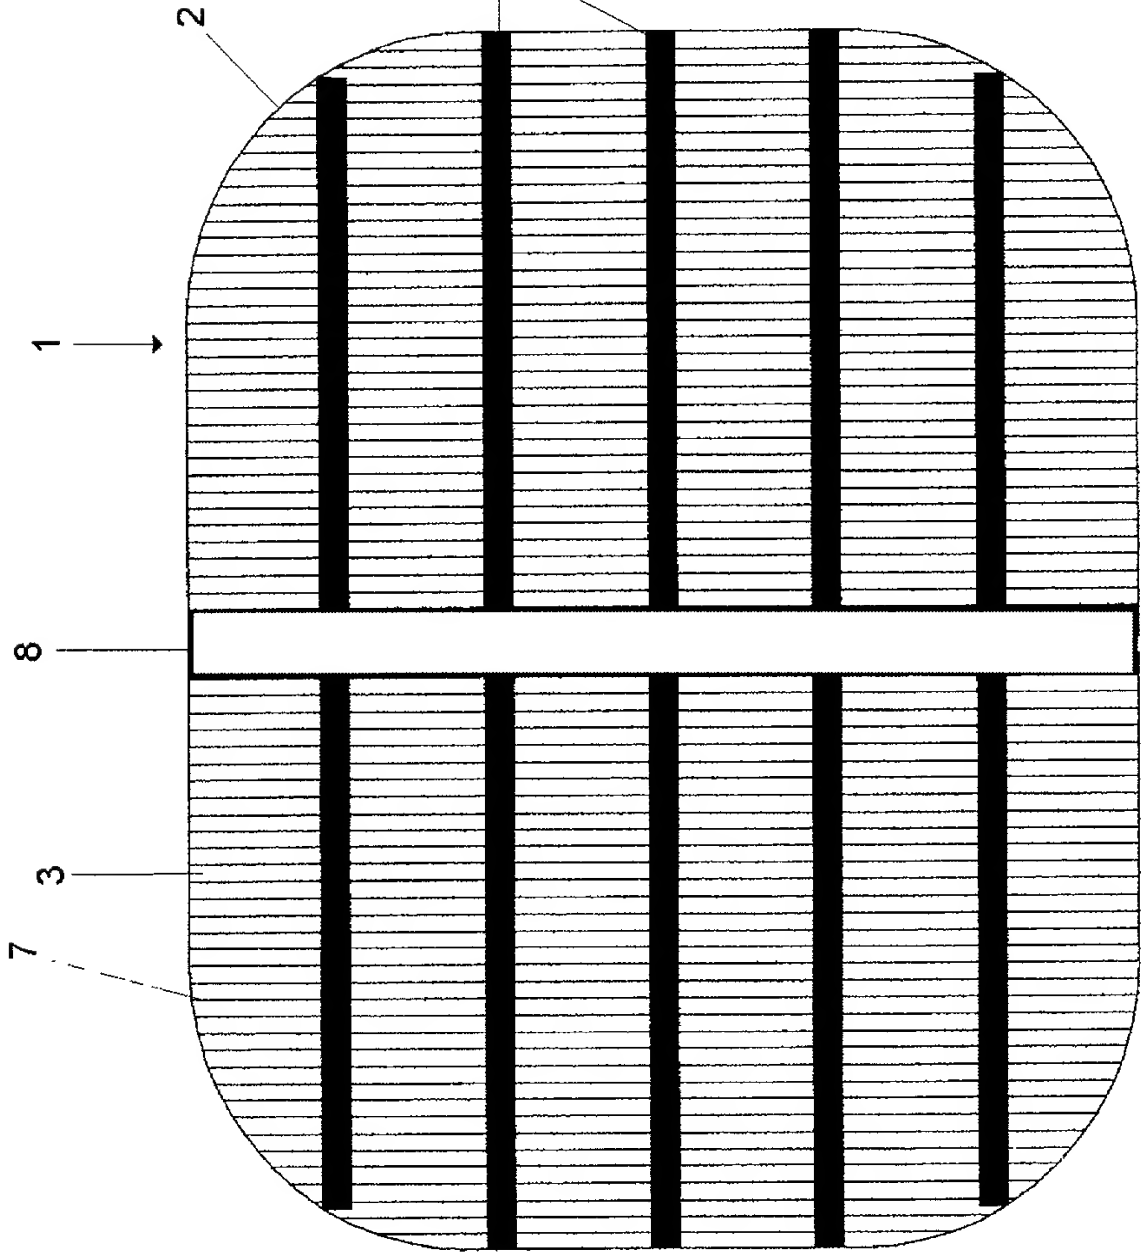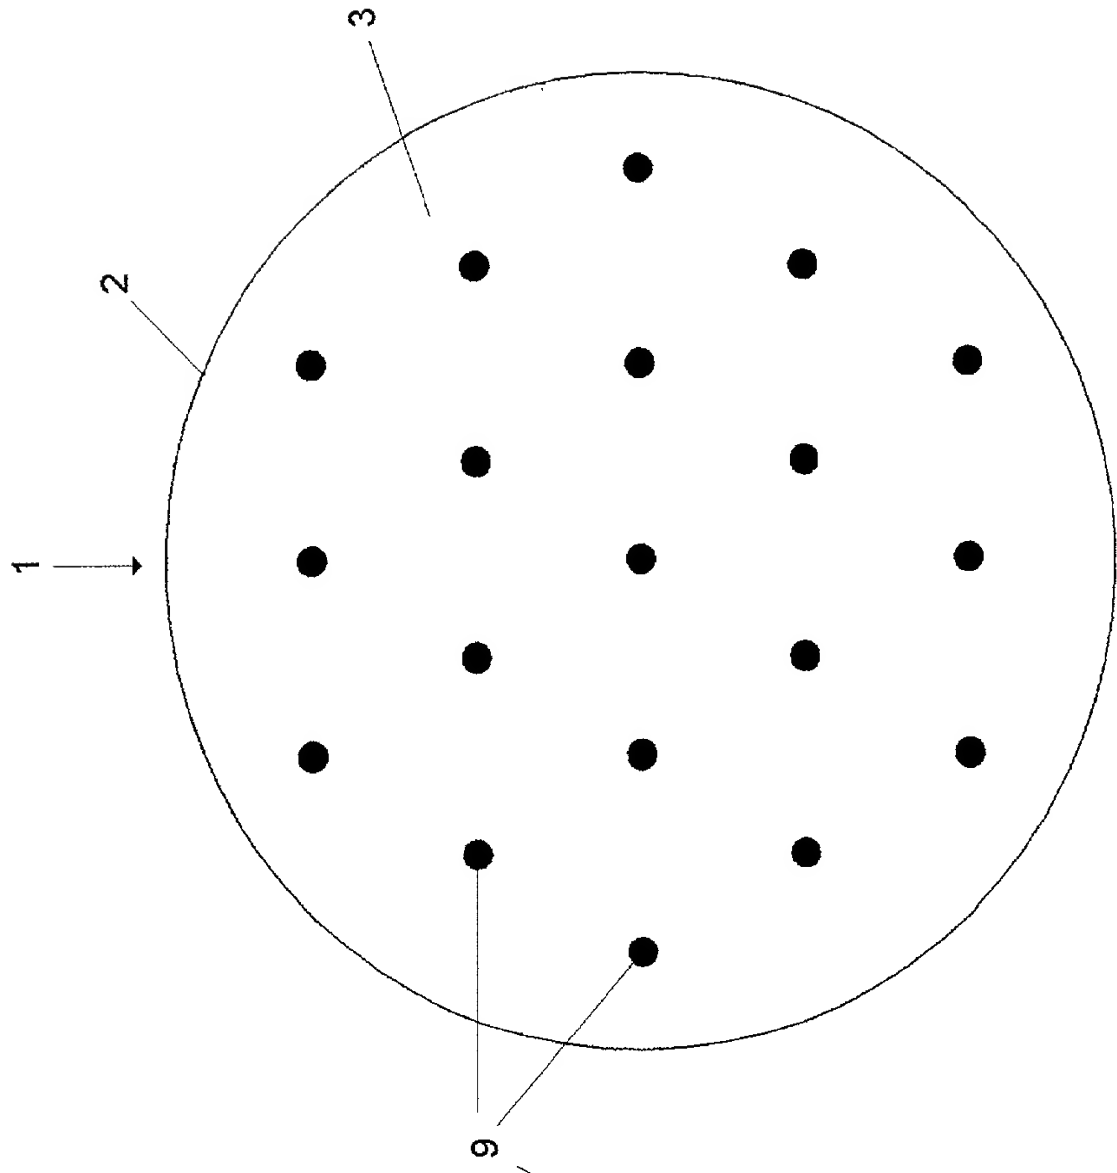Hydrogen Absorption (g) vs Time (min.)

A Air Cooling
B Water Cooling

Figure 4

Figure 5

Figure 6

Figure 7

Figure 8b

Figure 8a

Figure 9a

Figure 9b